NOTES:

1. MORTAR JOINTS SHALL BE 1/2 " MINIMUM THICKNESS WITH STAGGERED INTERLACED JOINTS.
2. HEIGHT OF WALLS SHALL BE A MINIMUM OF 12" OR A.O.B.E.
3. BRICK CATCH BASINS SHALL BE USED IN THE RIGHT-OF-WAY OUTSIDE THE PAVEMENT SECTION.
4. BRICK CATCH BASINS SHALL BE APPROVED IN ADVANCE BY M.C.D.O.T.

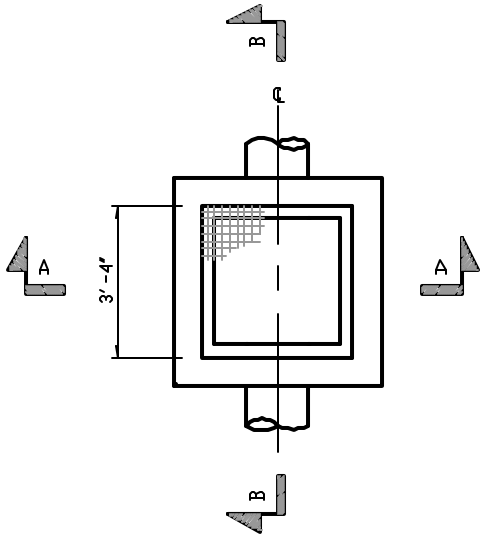

PLAN

FRAMES & GRATES-ITEM 655.02 M
TYPE 'A' (NO. 9)
FRAME: 2'-4 15/16 " X 2'-3 1/2 " GRATE: 2'-3 11/16 " X 2'-2 1/2 "

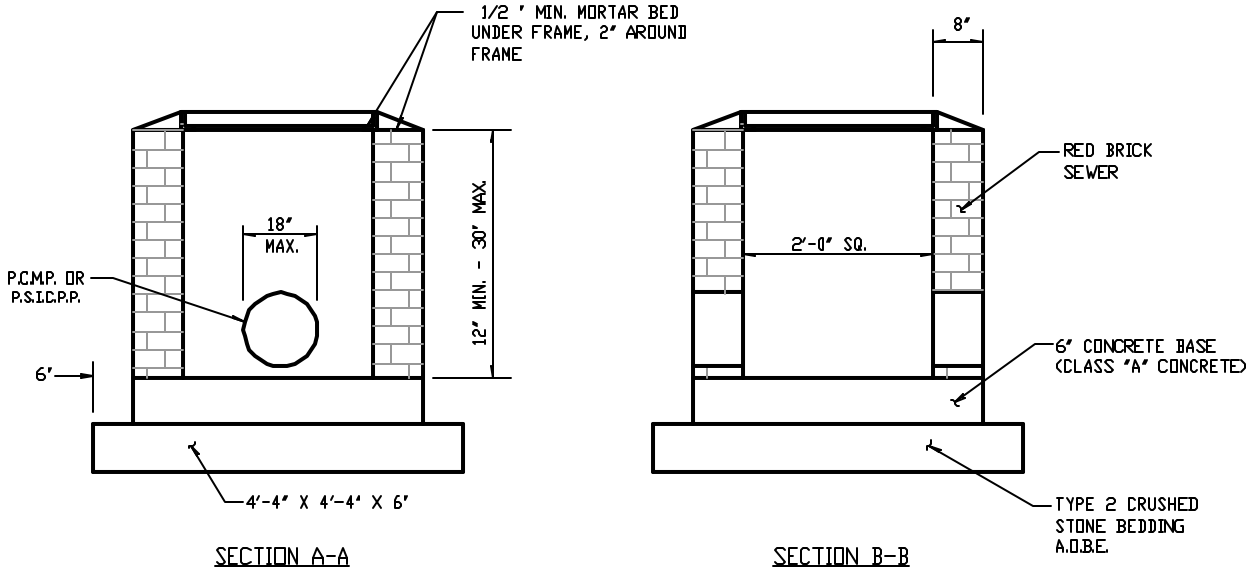

SECTION A-A

SECTION B-B

FIELD INLET - BRICK CATCH BASIN

NOT TO SCALE

4/1/98

REVISED