REVISED 10/1/00

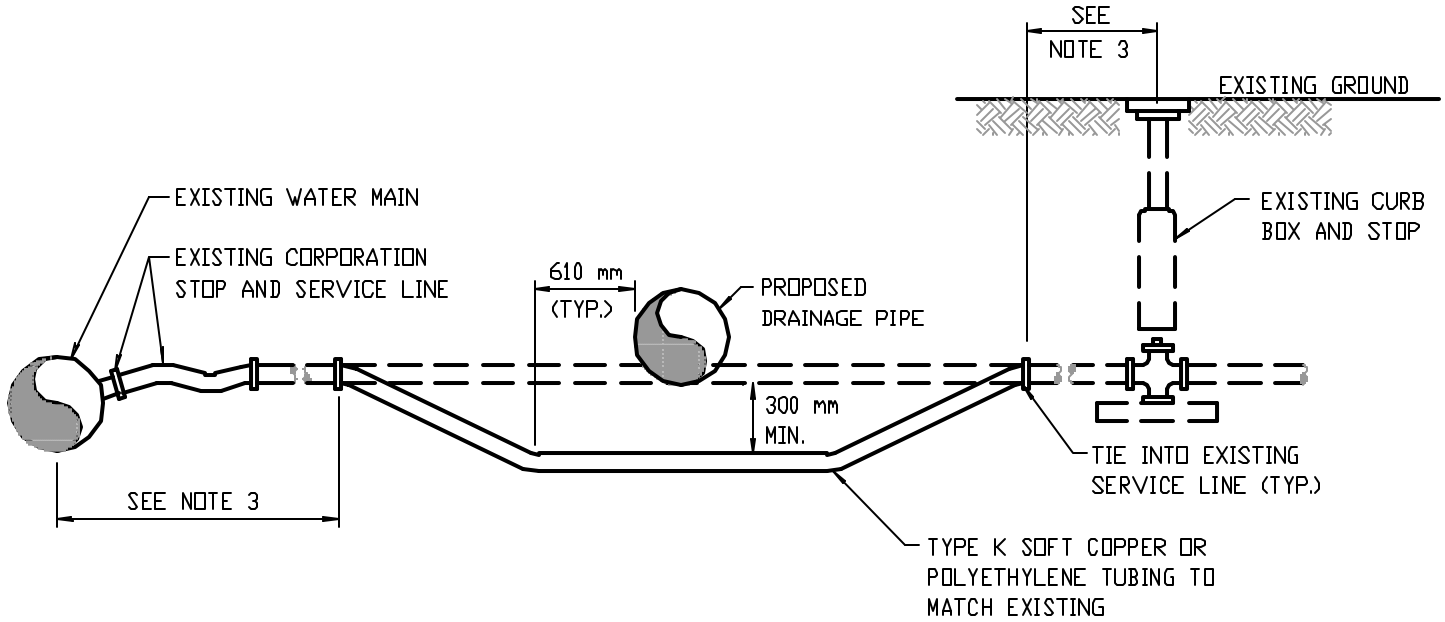

NOTES:

1. MAKE CONNECTIONS BETWEEN EXISTING AND NEW PIPES WITH COMPRESSION FITTINGS.

2. MATCH SERVICE RELOCATION CONNECTION PIPE WITH EXISTING MATERIAL TYPE AND SIZE, 20mm MINIMUM.

3. WHEN THE DISTANCE IS 1.5 m OR LESS, RE-ESTABLISH THE WATER SERVICE WITH NEW PIPING TO THE MAIN AND/OR THE CURB STOP AS APPROPRIATE.

4. MONROE COUNTY WATER AUTHORY MUST BE NOTIFIED (716-442-2000 EXT. 238) WHEN THIS WORK IS TO TAKE PLACE, FOR INSPECTION AND MEASUREMENTS.

WATER SERVICE RE-ESTABLISH CONNECTION

NOT TO SCALE