REVISED 3/17/03

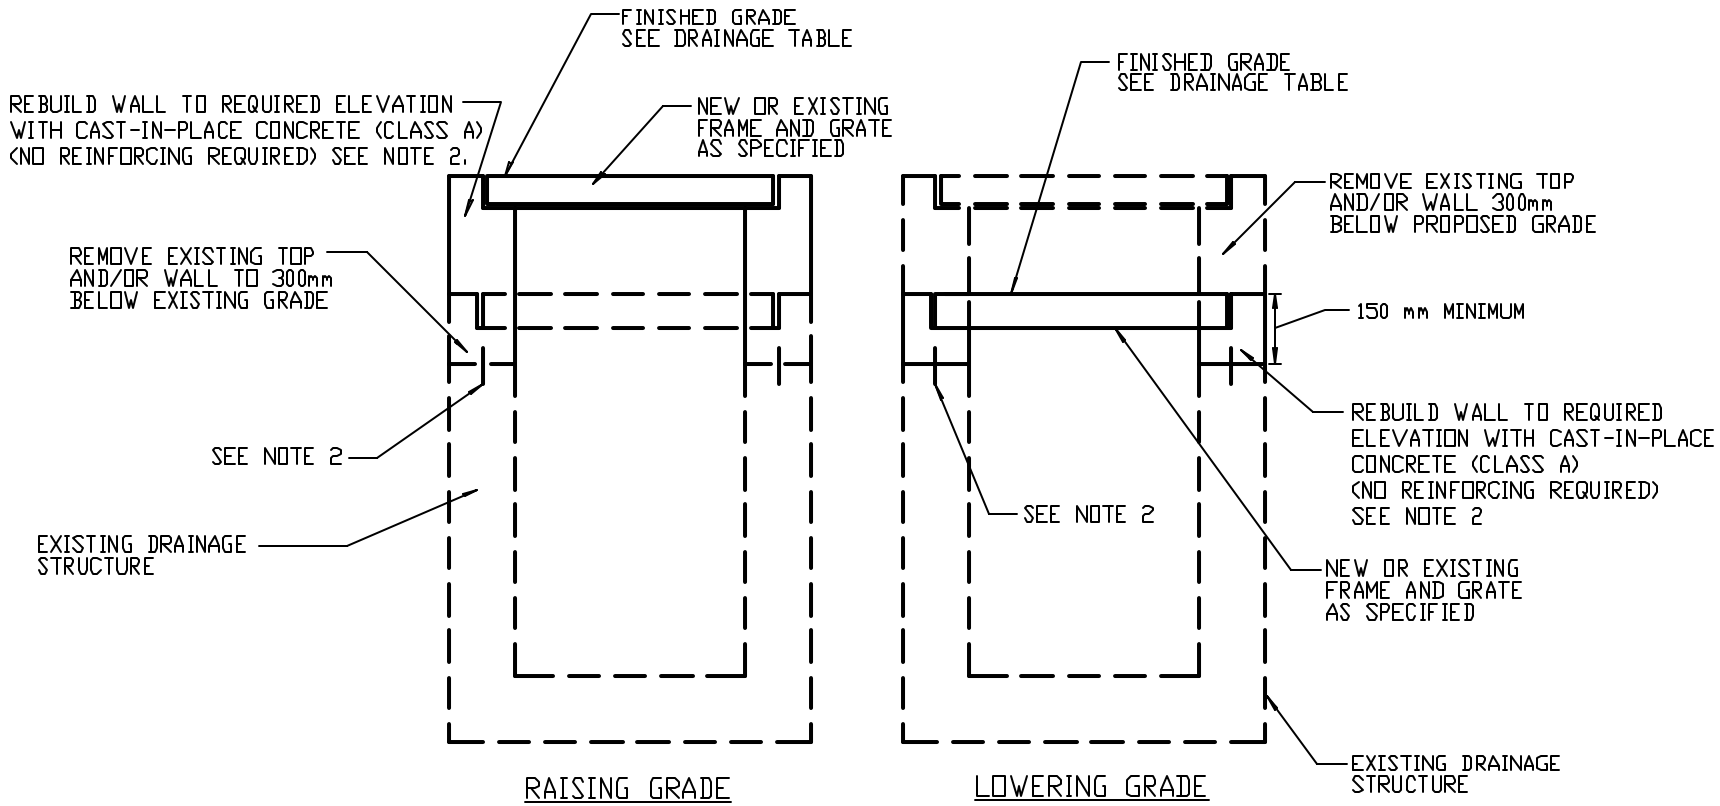


NOTES:

1. INTERIOR AND EXTERIOR OF REBUILT WALLS SHALL BE COATED WITH TWO COATS KOPPERS SUPER SERVICE BLACK OR APPROVED EQUAL (AFTER BENCH INSTALLED)
2. DRILL AND GROUT #16 BAR DOWELS, 3 PER SIDE MINIMUM, WITH 150mm MINIMUM EMBEDMENT INTO OLD AND NEW CONCRETE. ALL EXISTING CONCRETE SURFACES THAT WILL BE IN CONTACT WITH NEW CONCRETE SHALL BE COATED WITH EPOXY POLYSULFIDE GROUT PER NYSDOT SPECIFICATIONS 721-03. COST OF THIS WORK TO BE INCLUDED IN THE PRICE BID FOR ITEM 604.07 M

## ALTER EXISTING DRAINAGE STRUCTURES

ITEM 604.07 M

NOT TO SCALE