
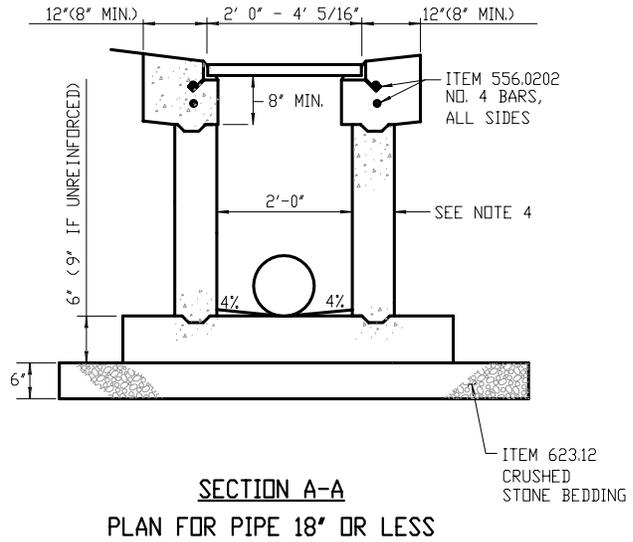
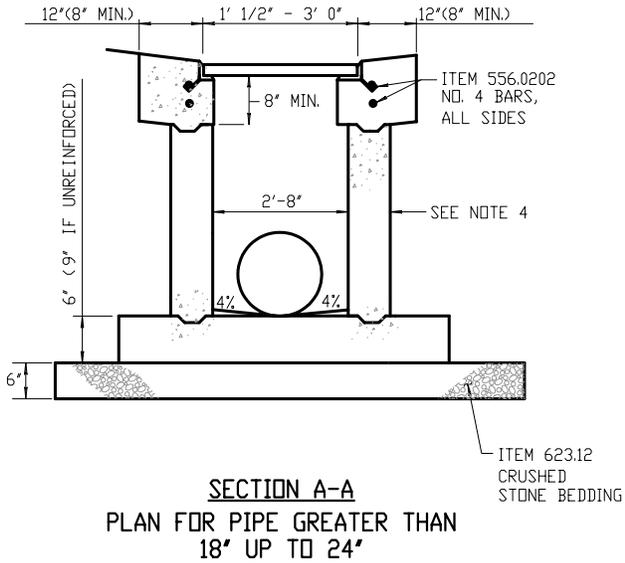
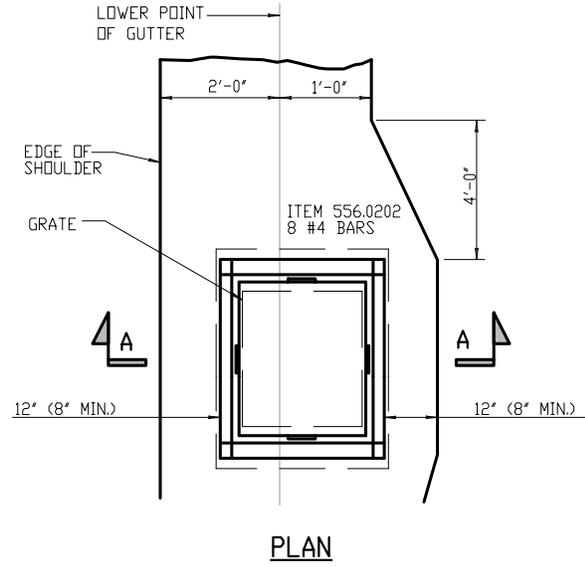


NOTES:

- ITEM 655.02 FRAME & GRATE- FRAME 2'-4 15/16" X 3'-1 1/2" GRATE 2'-3 11/16" X 3'-0 1/2" RECTANGULAR FRAME & GRATE ASSEMBLY TYPE NO. 11, SEE N. Y. S. D. O. T. STANDARD SHEETS 655-4R1, 655-5R1, 655-6R1 AND 655-3. PAYMENT AREA = 7.2 SQ. FEET.
- REINFORCEMENT SHALL HAVE A COVER OF 2" UNLESS OTHERWISE SHOWN. THE COST OF ALL BAR REINFORCEMENT SHALL BE INCLUDED IN THE PRICE BID FOR DROP INLETS.
- THE INTERIOR AND EXTERIOR OF ALL DROP INLETS TO BE COATED WITH TWO COATS OF KOPPERS SUPER SERVICE BLACK OR APPROVED EQUAL.
- CLASS "A" CONCRETE IS TO BE USED. WALL THICKNESS SHALL BE 6" IF REINFORCED, 8" IF UNREINFORCED. ALL PIPE CONNECTIONS SHALL BE MADE WITH 100% MORTAR.
- CLASS "A" CONCRETE BENCHES SHALL BE CAST-IN-PLACE ON ALL STORM DROP INLETS REGARDLESS OF PIPE DIAMETER. COST TO BE INCLUDED IN DROP INLET ITEM.
- INSIDE DIMENSIONS SHALL BE 2'-0" X 2'-8".
- REFER TO FRAME & GRATE ANCHOR DETAIL.
- STEPS WILL NOT BE ALLOWED.

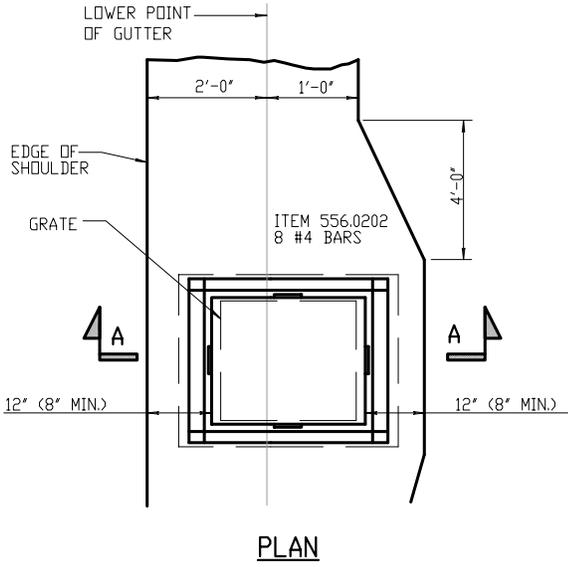

**DROP INLET TYPE "S" CAST-IN-PLACE WITH GUTTER**  
NOT TO SCALE

11/16/04

REVISED