
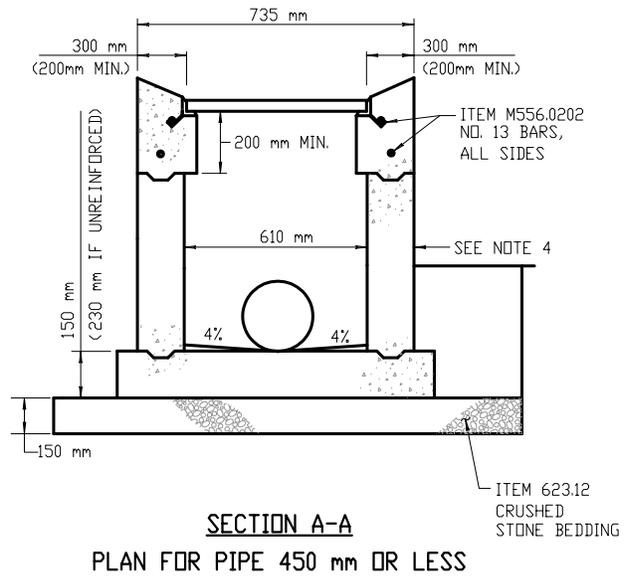
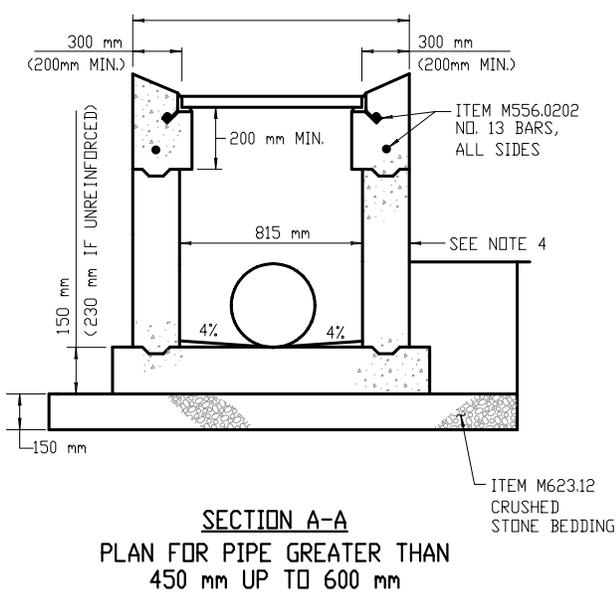
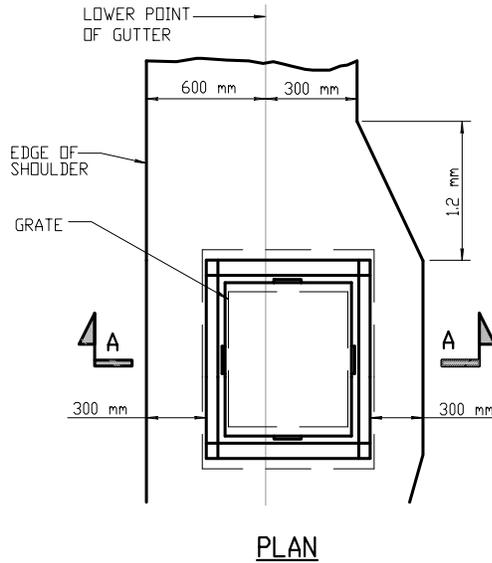


NOTES:

- ITEM 655.02 M FRAME & GRATE- FRAME 735 mm X 952 mm GRATE 703 mm X 927 mm RECTANGULAR FRAME & GRATE ASSEMBLY TYPE NO. 11, SEE N. Y. S. D. D. T. STANDARD SHEETS SHEETS M655-6 AND M655-11R1. PAYMENT AREA = 0.669 SQ. METERS.
- REINFORCEMENT SHALL HAVE A COVER OF 50 mm UNLESS OTHERWISE SHOWN. THE COST OF ALL BAR REINFORCEMENT SHALL BE INCLUDED IN THE PRICE BID FOR DROP INLETS.
- THE INTERIOR AND EXTERIOR OF ALL DROP INLETS TO BE COATED WITH TWO COATS OF KOPPERS SUPER SERVICE BLACK OR APPROVED EQUAL.
- CLASS "A" CONCRETE IS TO BE USED. WALL THICKNESS SHALL BE 150 mm IF REINFORCED, 200 mm IF UNREINFORCED. ALL PIPE CONNECTIONS SHALL BE MADE WITH 100% MORTAR.
- CLASS "A" CONCRETE BENCHES SHALL BE CAST-IN-PLACE ON ALL STORM DROP INLETS REGARDLESS OF PIPE DIAMETER. COST TO BE INCLUDED IN DROP INLET ITEM.
- INSIDE DIMENSIONS SHALL BE 610 mm x 825 mm.
- REFER TO FRAME & GRATE ANCHOR DETAIL.
- STEPS WILL NOT BE ALLOWED.

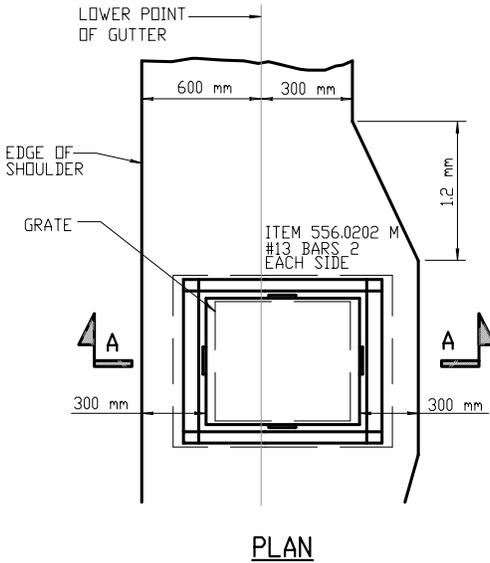

DROP INLET TYPE "S" CAST-IN-PLACE WITH GUTTER
NOT TO SCALE

11/16/04

REVISED