


PLUGGING ABANDONED STORM MANHOLE

NOTES:

1. EXCAVATION FOR REMOVAL OF EXISTING DRAINAGE STRUCTURE TO BE PAID FOR UNDER ITEM 206.02 - TRENCH AND CULVERT EXCAVATION.
2. REMOVE TOP AND SIDES OF EXISTING STRUCTURE TO A DEPTH OF 22" MINIMUM OR A.D.B.E. BELOW THE TOP OF THE EXISTING GRADE.
3. LONGER RUNS OF PIPE TO BE ABANDONED SHALL REQUIRE PUMPING OF CLSM. A THREADED COUPLER SHALL BE INSTALLED ON END AND A RISER PIPE FOR AIR RELIEF SHALL BE INSTALLED ON THE OTHER.

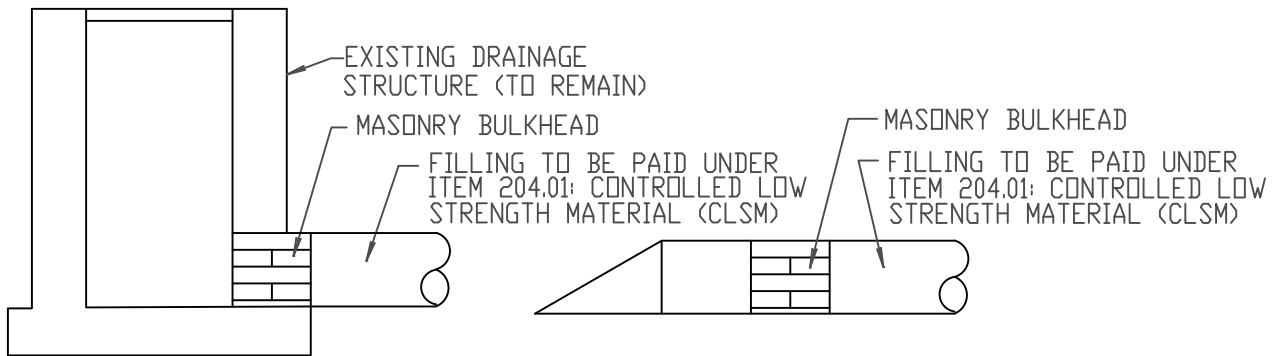

PLUGGING ABANDONED PIPE

ABANDONING EXISTING STORM SEWER

NOT TO SCALE