


GRANITE CURB, TYPE C

ASPHALT CONCRETE COURSES
1 1/2" TOP, 2" BINDER
AND TACK COAT

REFER TO TYPICAL
SECTION FOR RESTORATION

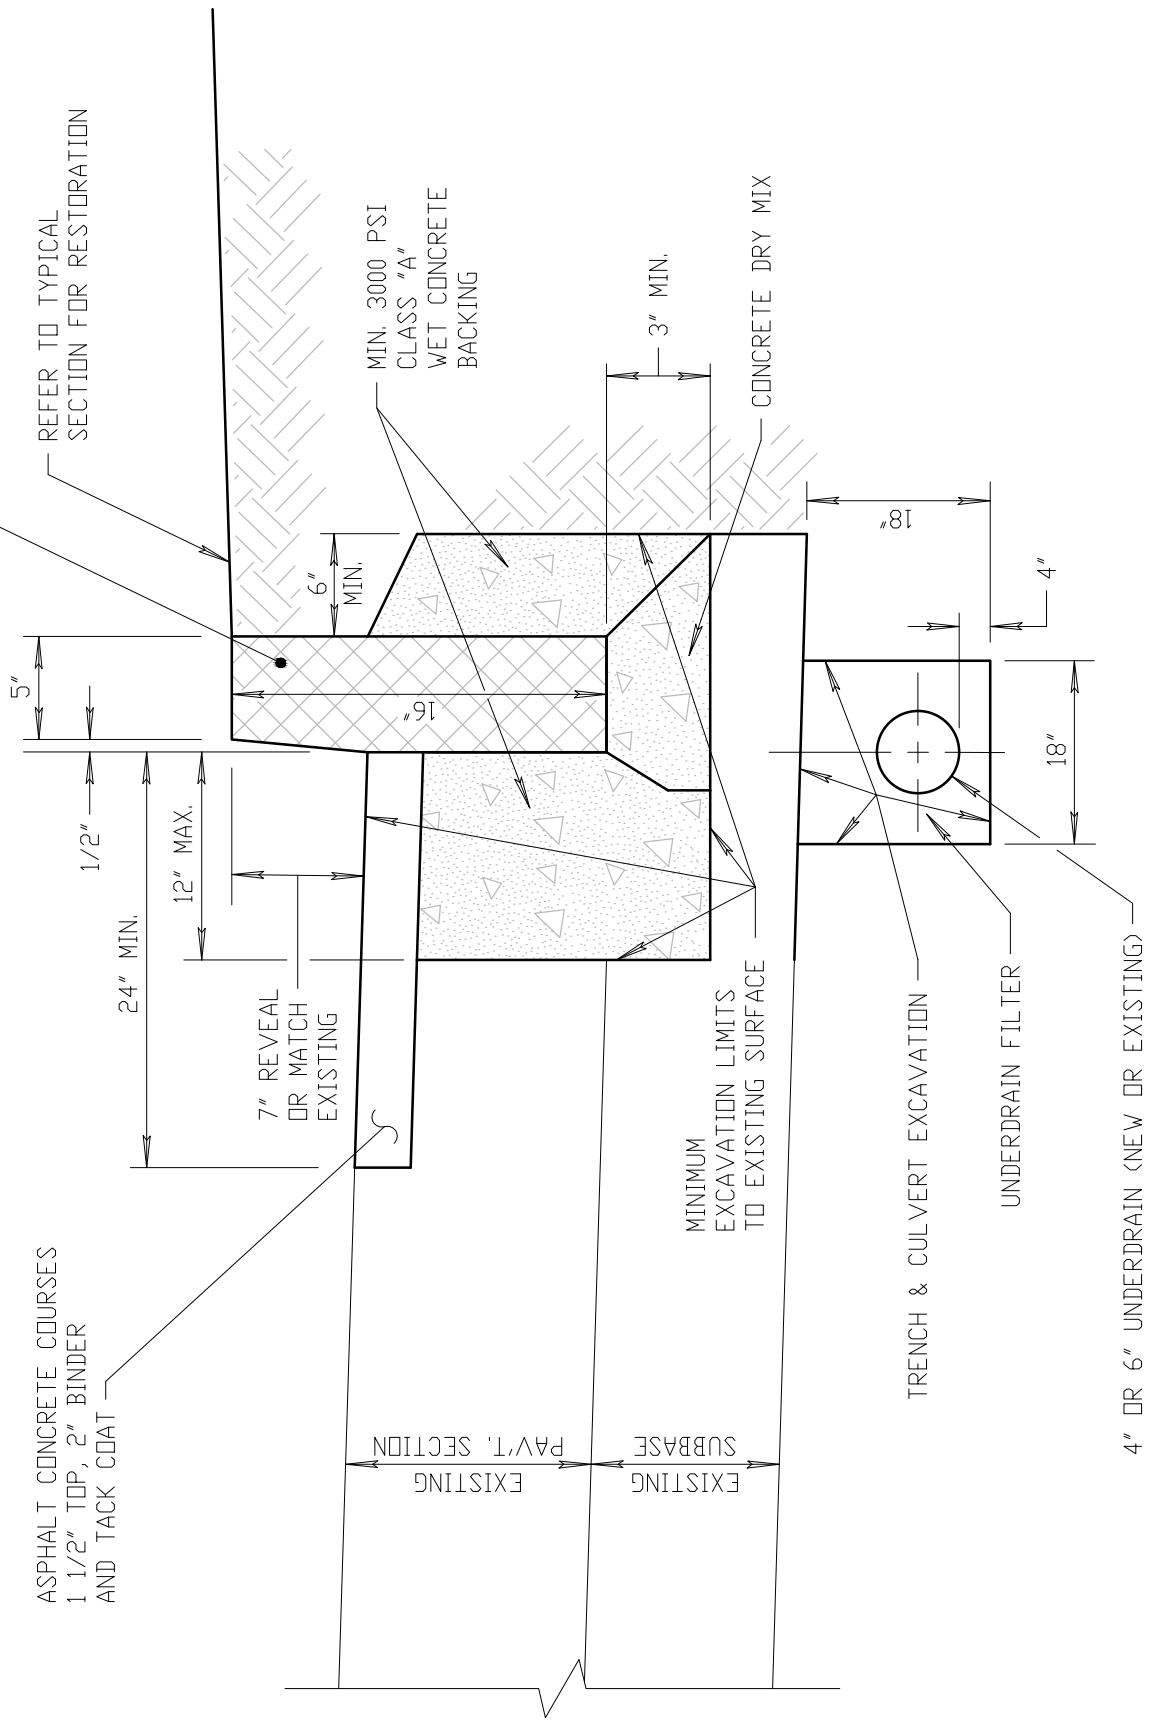

MIN. 3000 PSI
CLASS "A"
WET CONCRETE
BACKING

CONCRETE DRY MIX

7" REVEAL
OR MATCH
EXISTING

MINIMUM
EXCAVATION LIMITS
TO EXISTING SURFACE

EXISTING
PAV'T. SECTION

EXISTING
SUBBASE

TRENCH & CULVERT EXCAVATION

UNDERDRAIN FILTER

4" OR 6" UNDERDRAIN (NEW OR EXISTING)

GRANITE CURB REPLACEMENT WITH PERFORATED UNDERDRAIN

NOT TO SCALE

9/25/14

REVISED