


3/1/06

REVISED

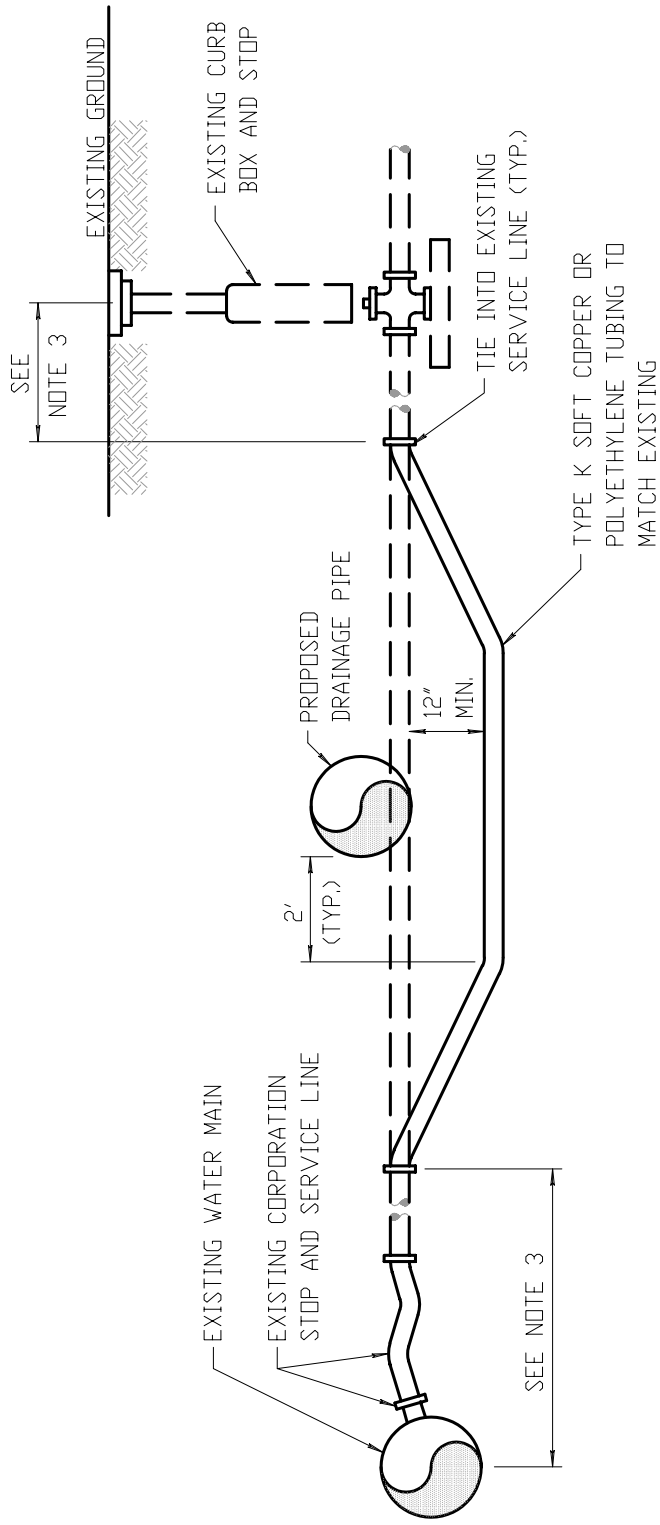

NOTES:

1. MAKE CONNECTIONS BETWEEN EXISTING AND NEW PIPES WITH COMPRESSION FITTINGS.
2. MATCH SERVICE RELOCATION CONNECTION PIPE WITH EXISTING MATERIAL TYPE AND SIZE, 3/4" MINIMUM.
3. WHEN THE DISTANCE IS 5' OR LESS, RE-ESTABLISH THE WATER SERVICE WITH NEW PIPING TO THE MAIN AND/OR THE CURB STOP AS APPROPRIATE.
4. MONROE COUNTY WATER AUTHORITY MUST BE NOTIFIED (716-442-2000 EXT. 238) WHEN THIS WORK IS TO TAKE PLACE, FOR INSPECTION AND MEASUREMENTS.

WATER SERVICE - RE-ESTABLISH CONNECTION

NOT TO SCALE